


ONE

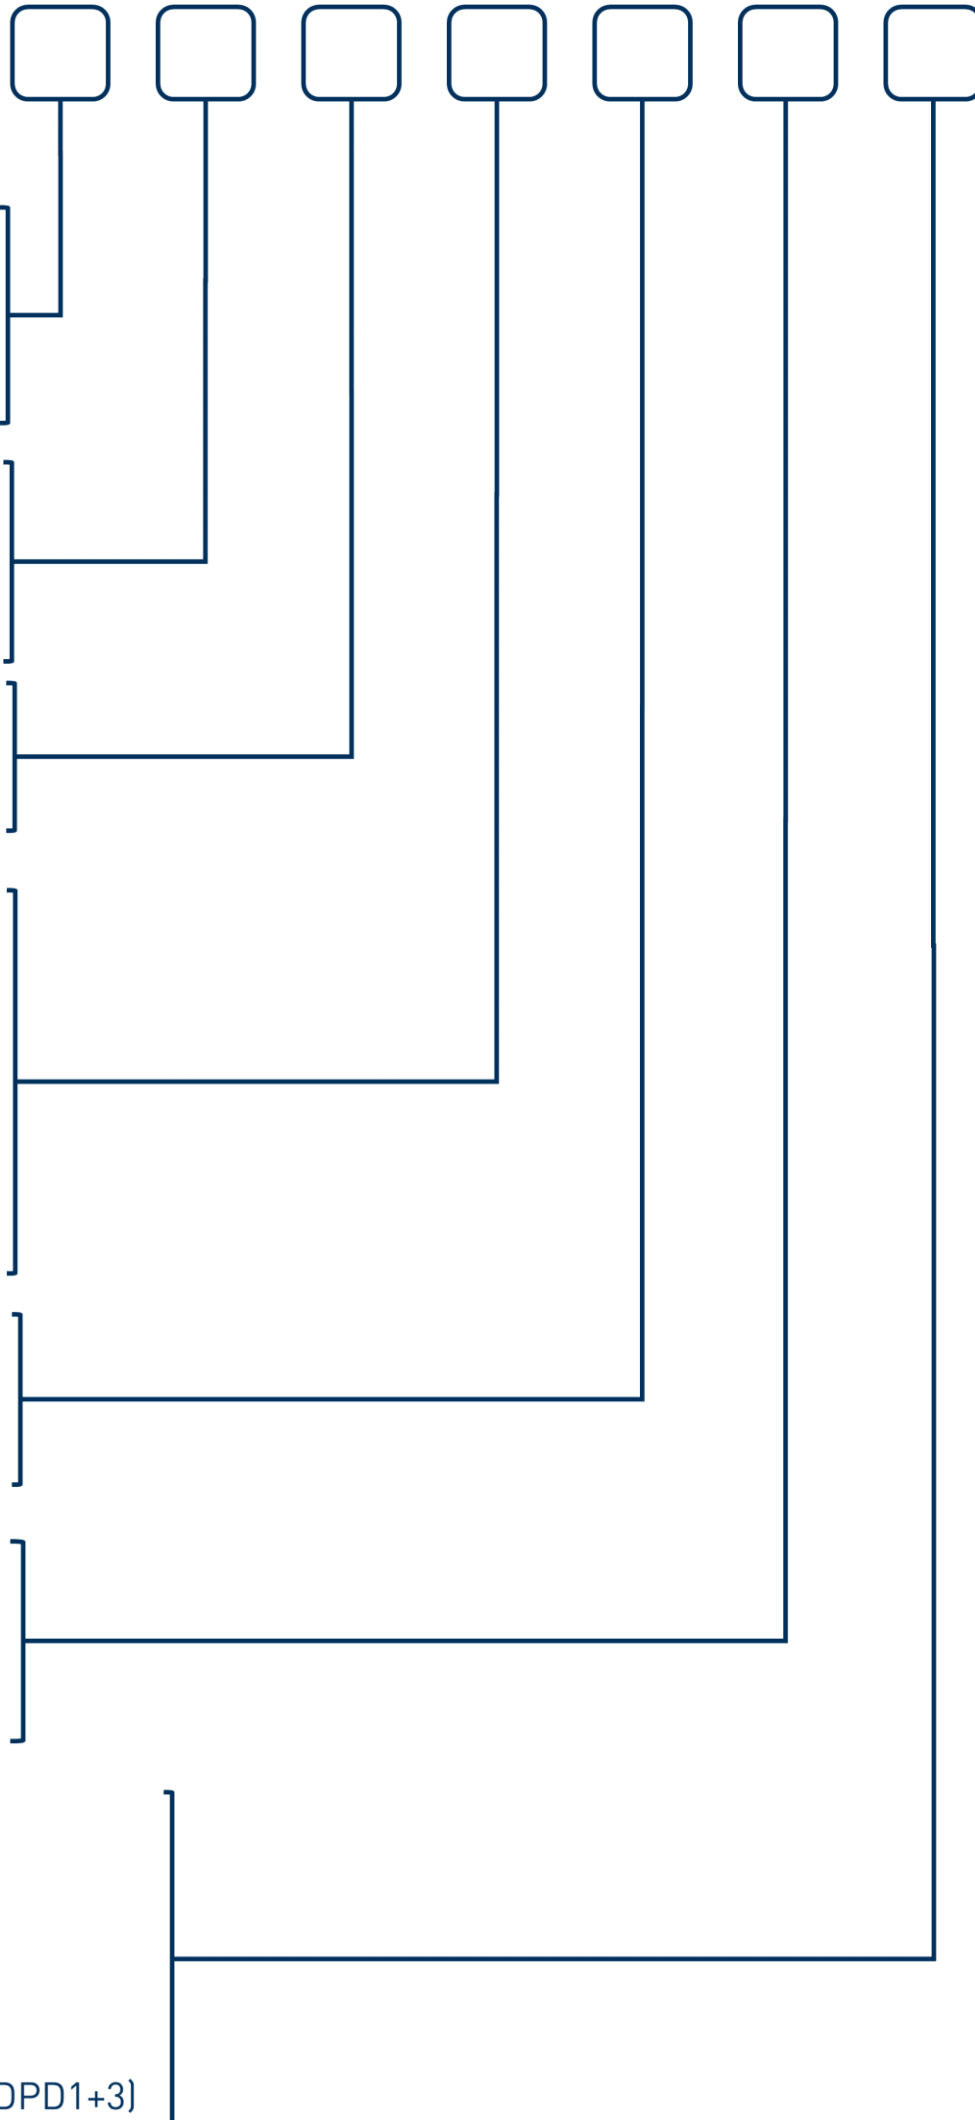

Brand

- B – BIWT
- T – Internal needs
- U – US

Region regulations

- G – General
- C – China

Relay

- 0- No Relay outputs
- 1- 8 X Relay outputs

Parameters

- 0 – No sensors
- 1 – pH Only
- 2 – pH + Redox (ORP)
- 3 – pH + Redox (ORP) + Conductivity
- 4 – Redox (ORP) Only
- 5 – Conductivity Only *
- 6 – Conductivity + pH *

Analog Input

- 0- no 4-20mA input
- 1- 4 X 4-20mA input

Analog Output

- 0 – No Outputs
- 2 – 4 X 4-20mA Outputs
- 3 – 8 X 4-20mA Outputs

Chlorine (0-10ppm) & Turbidity

- 0 – Free Chlorine (DPD1)
- 1 – Total Chlorine (DPD4)
- 2 – Free & Total Chlorine (DPD1+3)
- 3 - Free Chlorine + Turbidity (DPD1)
- 4 – Total Chlorine + Turbidity (DPD4)
- 5 – Free + Total Chlorine + Turbidity (DPD1+3)

* Conductivity – 0-5000µs

** Temperature is a Default parameter